

Mirvac Real Estate Pty Ltd

Hazardous Chemicals Assessment

664 Collins Street, Melbourne, Victoria 3000

5 June 2024

Project Ref: 754-SYDEN228268 - 664 Collins St Hazchem Report 2024



HAZARDOUS CHEMICALS ASSESSMENT

Prepared for
Mirvac Real Estate Pty Ltd

Prepared by
Tetra Tech Coffey Pty Ltd
Level 20, Tower B, 799 Pacific Highway
Chatswood NSW 2067 Australia
t: +61 2 9406 1000 f: +61 2 9406 1002
ABN: 55 139 460 521

Quality information

Revision history

Revision	Description	Date	Originator	Reviewer	Approver
R00	Final	5/06/2024	Ben Mcann	Richard Wilkinson	Richard Wilkinson

Distribution

Report Status	No. of copies	Format	Distributed to	Date
R00 Final	1	PDF	Mirvac	5/06/2024

5 June 2024

754-SYDEN228268 - 664 Collins St Hazchem Report 2024

CONTENTS

1.	Introduction.....	1
1.1	Site Description	1
1.2	Assessment Objectives	1
2.	Methodology	1
2.1	Inaccessible Areas	1
3.	Duties of the Site Occupier / Employer	2
4.	Background Information	2
4.1	Definitions	2
4.2	Dangerous Goods Classes	3
4.3	Packing Group	3
5.	Assessment Findings	3
5.1	Summary of Hazardous Chemicals Identified on Site	3
5.2	Observations	4
6.	Recommended Actions	5
6.1	High Priority (action within 1 month)	5
6.2	Medium Priority (action within 3 months)	5
6.3	Low Priority (action within 6 months)	5
7.	References	5
8.	Limitations	6
	Appendix A: Photographs	7
	Appendix B: Hazardous Chemicals Register	9

EXECUTIVE SUMMARY

Tetra Tech Coffey Pty Ltd (Tetra Tech) was commissioned by Mirvac Real Estate Pty Ltd (the client) to conduct a Hazardous Chemicals Assessment (assessment) of the office building located at 664 Collins Street, Docklands, Victoria (the site). Ben McCann conducted the assessment on 22nd April 2024. The term 'Hazardous Chemicals' in this report has been used to refer to both dangerous goods and hazardous substances, as defined under the *Dangerous Goods (Storage and Handling) Regulations, 2012* and the *Occupational Health and Safety Regulations, 2017*.

Assessment Findings

Summary of Hazardous Chemicals Identified on Site

The following table presents a summary of the approximate total volumes of hazardous chemicals stored on site by dangerous goods class. It also details whether placarding and/or manifests are required for any dangerous goods stored in bulk at the site.

Dangerous Goods Class	Approximate Quantity Stored on Site (L or Kg)	Placarding Required	Manifest Required
Class 2.1	-	-	-
Class 2.2	1,510kg	-	-
Class 3	5L	-	-
Class 5.1 and 5.2	30kg	-	-
Class 6.1	-	-	-
Class 8	148L	-	-
Class 9	-	-	-
C1 Combustible Liquid	1,100L	-	-
Non-Dangerous Goods and Products with Unknown Classes	161.3L	-	-

Observations

The following observations were made at the time of the assessment:

- Quantities of hazardous chemicals stored on site did not exceed the threshold levels for placarding and manifest requirements.
- The majority of inspected hazardous chemicals observed on site were securely stored in sealed containers and provided with adequate secondary containment, however a number of chemical containers in the Level 13 Cooling Tower Room were not stored within appropriate spill containment.
- The majority of inspected hazardous chemicals appeared to be appropriately labelled, however unlabelled chemical containers were observed in the Level 3 Plant Room and the Level 13 Cooling Tower Room.

- Hazardous chemical storage areas were secured from unauthorised access (e.g. within locked rooms).
- Spill kits were available in the majority of chemical storage areas (e.g. Fire Pump Room and Level 13 Chiller Room), however a spill kit was not available within the Level 3 Cleaners Store Room.
- Incompatible hazardous chemicals generally appeared to be appropriately segregated, however Class 3 flammable liquids and Class 8 corrosive substances were observed stored together in the Level 3 Cleaners Store Room.
- An emergency eye wash station was not available within close proximity to Class 8 corrosive substances stored in the Level 3 Cleaners Store Room or the Level 13 Cooling Tower Room.
- Appropriate fire safety measures appeared to be available within hazardous chemical storage areas e.g. dry chemical fire extinguishers in diesel storage areas.
- Safety Data Sheets (SDSs) were available for the majority of hazardous chemicals stored on site, however SDSs were not available for a number of the hazardous chemicals in most storage areas (refer to Hazardous Chemicals Register).
- The majority of the SDSs reviewed on site were current (within 5 years of issue date), however a number of the SDSs reviewed were not current (refer to Hazardous Chemicals Register).

Recommendations

The following recommended actions (and the associated indicative recommended timeframes) are provided based on the findings and observations presented above:

High Priority (action within 1 month)

No high priority actions are required.

Medium Priority (action within 3 months)

- Ensure that Class 3 flammable liquids and Class 8 corrosive substances in the Level 3 Cleaners Store Room are kept apart by at least 3m.

Low Priority (action within 6 months)

- Ensure that all hazardous chemicals stored on site, in particular those in the Level 13 Cooling Tower Room, are stored within appropriate secondary containment.
- Ensure the unlabelled containers in the Level 3 Plant Room and the Level 13 Cooling Tower Room are either appropriately labelled or removed from the site.
- Install an appropriate spill kit in the Level 3 Cleaners Store Room.
- Install an emergency eye wash station adjacent to (within 2-10m) the Class 8 corrosive substances stored in the Level 3 Cleaners Store Room or the Level 13 Cooling Tower Room.
- Ensure that printed SDS copies are available and readily accessible for all hazardous chemicals in each relevant storage area, as well as within a central storage hub.
- Replace any outdated SDSs with current copies.
- Require as a condition of service contract, that all contractors engaged at the site provide a register of the chemicals they intend to use/store on site as well as a current SDS.
- Ensure all staff and contractors working within chemical storage areas at the site are provided with appropriate information, instruction and training to ensure they are able to work safely in these areas. It is recommended that this be managed within the site induction.
- Implement a periodic hazardous chemicals assessment at the site to ensure the requirements are being maintained and the register remains current. It is recommended that such a review is performed at least annually, or when significant changes are made to the hazardous chemicals used/stored on site.

- A copy of this report and register should be made available to any staff and contractors working within the relevant areas at the site.

1. INTRODUCTION

Tetra Tech Coffey Pty Ltd (Tetra Tech) was commissioned by Mirvac Real Estate Pty Ltd (the client) to conduct a Hazardous Chemicals Assessment (assessment) of the office building located at 664 Collins Street, Docklands, Victoria (the site). Ben McCann conducted the assessment on 22nd April 2024. The term 'Hazardous Chemicals' in this report has been used to refer to both dangerous goods and hazardous substances, as defined under the *Dangerous Goods (Storage and Handling) Regulations, 2012* and the *Occupational Health and Safety Regulations, 2017*.

1.1 Site Description

The site consisted of a 10 level (approximately 26,476m²) office building, constructed in 2018. The building was occupied at the time of the assessment. Key chemical storage areas included the Cleaners Store Room, Fire Pump Room, Chiller Room and Cooling Tower Area.

1.2 Assessment Objectives

The objectives of this assessment were as follows:

- Conduct a visual inspection of all common areas (tenanted areas were not included) at the site.
- Liaise with relevant site personnel and collect data on the location, type, quantities, use and function of the hazardous chemicals stores on site.
- Assess the risks associated with the storage of hazardous chemicals on site.
- Evaluate the effectiveness of risk control measures implemented at the site to manage hazardous chemical storage.
- Provide recommended actions to rectify any identified non-conformances and minimise the identified risks.
- Prepare an up-to-date hazardous chemicals register for the site.

2. METHODOLOGY

The assessment consisted of an on-site visual inspection to identify and assess, so far as reasonably practicable, the presence, location and condition of hazardous chemicals at, on, and associated with the site. Areas were visually inspected for containers and storage vessels that may contain any potentially hazardous chemicals. Visual assessment of the type of all hazardous chemicals identified was conducted with product details recorded including estimated volumes, and whether the contents were labelled or indicated through signage. All chemical storage areas were accessed, where reasonably practicable, and where no access was available, locations were recorded within Section 2.1 of this report. The assessment was carried out methodically, systematically and diligently to make sure all relevant areas of the premises were inspected.

Hazardous properties of each hazardous chemical stored on site were collated from the Safety Data Sheets (SDS). Where the SDS was unavailable, generic hazardous properties for the class of dangerous goods were used. For each hazardous property identified, an assessment was made to determine whether this hazardous property resulted in a risk to occupants of the chemical storage area or any adjacent areas.

Data collected during the assessment was compared to the legislative documents and standards listed in Section 7.

2.1 Inaccessible Areas

The following areas were not accessible at the time of the assessment. The presence/absence of hazardous chemicals in these areas cannot be confirmed until further investigation can confirm or refute the presence.

- Occupied areas/tenancies.
- Areas not specified as chemical storage areas.

3. DUTIES OF THE SITE OCCUPIER / EMPLOYER

An occupier / employer of a premises where hazardous chemicals are stored and handled has a duty to identify the hazards associated with the hazardous chemicals and control the risks arising from their storage and handling. The following duties must also be carried out by the site occupier / employer:

- Provide appropriate consultation, training, induction and supervision to all workers who are required to work within hazardous chemical storage areas.
- Prepare a register of all hazardous chemicals stored or used at the site.
- Obtain current SDSs for all hazardous chemicals stored or used on site.
- Prepare a manifest of any hazardous chemicals stored in bulk quantities above the relevant threshold limits.
- Display appropriate placards for hazardous chemicals stored in bulk quantities above the relevant threshold limits.
- Ensure hazardous chemical storage areas are appropriately ventilated.
- Ensure hazardous chemical containers and pipework are protected from damage.
- Ensure all hazardous chemical containers and pipework are appropriately labelled.
- Ensure that incompatible hazardous chemicals are appropriately segregated.
- Ensure appropriate spill containment provisions are provided for all hazardous chemicals.
- Ensure suitable fire safety measures are available and appropriately maintained.
- Provide health monitoring to workers who may be exposed to hazardous chemicals in levels exceeding the relevant exposure standards.

Note: The above duties are specified in Part 4 of the *Dangerous Goods (Storage and Handling) Regulations, 2012* and Part 4.1 of the *Occupational Health and Safety Regulations, 2017*. The occupier / employer of this site is considered to be the Property Manager.

4. BACKGROUND INFORMATION

4.1 Definitions

Definitions of key terms used in this assessment report and within the hazardous chemicals register are provided below:

- Dangerous Goods – Substances capable of causing immediate harm to people and property because of their hazardous properties. They may be corrosive, flammable, combustible, explosive, oxidising or water-reactive or have other hazardous properties
- Hazardous Substances – Substances that have the potential to harm human health.
- Manifest – A summary of the key information about specific dangerous goods stored at a site, intended to be provided to emergency services in the event of an emergency. Only required for dangerous goods stored in large quantities over the threshold limits detailed in the *Dangerous Goods (Storage & Handling) Regulations, 2012*.
- Placard – Signage intended to provide a clear visual warning to emergency services that dangerous goods are stored at the site. They include outer warning placards, to be installed at the vehicle entrances to the site, and location placards, to be installed on or adjacent to each container or storage area. Only required for dangerous goods stored in large quantities over the threshold limits detailed in the *Dangerous Goods (Storage & Handling) Regulations, 2012*.

4.2 Dangerous Goods Classes

Classes of relevant dangerous goods are listed below:

- Class 2 – Gases.
 - Division 2.1 – Flammable gases.
 - Division 2.2 – Non-flammable, non-toxic gases.
 - Division 2.3 – Toxic gases.
- Class 3 – Flammable liquids.
- Class 4 – Flammable solids.
 - Division 4.1 – Flammable solids, self-reactive substances, and solid desensitized explosives.
 - Division 4.2 – Substances liable to spontaneous combustion.
 - Substances which in contact with water emit flammable gases.
- Class 5 – Oxidizing substances and organic peroxides.
 - Division 5.1 – Oxidizing substances.
 - Division 5.2 – Organic peroxides.
- Class 6 – Toxic and infectious substances.
 - Division 6.1 – Toxic substances.
 - Division 6.2 – Infectious substances.
- Class 8 – Corrosive substances.
- Class 9 – Miscellaneous dangerous substances and articles.
- C1 – Combustible liquids (liquids with a flashpoint greater than 60°C but less than 93°C and a fire point less than its boiling point).

Note: It is possible for substances to display more than one characteristic, therefore these substances may fall under more than one dangerous goods class. In such circumstances the substance will have a primary class and a subsidiary class. Subsidiary classes are displayed in brackets in the dangerous goods class column of the Hazardous Chemicals Register.

4.3 Packing Group

To further assist with the identification of dangerous goods and their particular hazards, Classes 3, 4, 5, 6 and 8 are assigned with a packing group. This represents the level of danger to persons exposed to the dangerous goods. Packing groups include the following:

- I – Great danger.
- II – Medium danger.
- III – Minor danger.

5. ASSESSMENT FINDINGS

The assessment findings are detailed in the following sections. Refer to **Appendix A** for a photographic supplement and **Appendix B** for the full Hazardous Chemicals Register.

5.1 Summary of Hazardous Chemicals Identified on Site

The following table presents a summary of the approximate total volumes of hazardous chemicals stored on site by dangerous goods class. It also details whether placarding and/or manifests are required for any dangerous goods stored in bulk at the site.

Dangerous Goods Class	Approximate Quantity Stored on Site (L or Kg)	Placarding Required	Manifest Required
Class 2.1	-	-	-
Class 2.2	1,510kg	-	-
Class 3	5L	-	-
Class 5.1 and 5.2	30kg	-	-
Class 6.1	-	-	-
Class 8	148L	-	-
Class 9	-	-	-
C1 Combustible Liquid	1,100L	-	-
Non-Dangerous Goods and Products with Unknown Classes	161.3L	-	-

5.2 Observations

The following observations were made at the time of the assessment:

- Quantities of hazardous chemicals stored on site did not exceed the threshold levels for placarding and manifest requirements.
- The majority of inspected hazardous chemicals observed on site were securely stored in sealed containers and provided with adequate secondary containment, however a number of chemical containers in the Level 13 Cooling Tower Room were not stored within appropriate spill containment.
- The majority of inspected hazardous chemicals appeared to be appropriately labelled, however unlabelled chemical containers were observed in the Level 3 Plant Room and the Level 13 Cooling Tower Room.
- Hazardous chemical storage areas were secured from unauthorised access (e.g. within locked rooms).
- Spill kits were available in the majority of chemical storage areas (e.g. Fire Pump Room and Level 13 Chiller Room), however a spill kit was not available within the Level 3 Cleaners Store Room.
- Incompatible hazardous chemicals generally appeared to be appropriately segregated, however Class 3 flammable liquids and Class 8 corrosive substances were observed stored together in the Level 3 Cleaners Store Room.
- An emergency eye wash station was not available within close proximity to Class 8 corrosive substances stored in the Level 3 Cleaners Store Room or the Level 13 Cooling Tower Room.
- Appropriate fire safety measures appeared to be available within hazardous chemical storage areas e.g. dry chemical fire extinguishers in diesel storage areas.
- Safety Data Sheets (SDSs) were available for the majority of hazardous chemicals stored on site, however SDSs were not available for a number of the hazardous chemicals in most storage areas (refer to Hazardous Chemicals Register).

- The majority of the SDSs reviewed on site were current (within 5 years of issue date), however a number of the SDSs reviewed were not current (refer to Hazardous Chemicals Register).

6. RECOMMENDED ACTIONS

The following recommended actions (and the associated indicative recommended timeframes) are provided based on the findings and observations presented above:

6.1 High Priority (action within 1 month)

No high priority actions are required.

6.2 Medium Priority (action within 3 months)

- Ensure that Class 3 flammable liquids and Class 8 corrosive substances in the Level 3 Cleaners Store Room are kept apart by at least 3m.

6.3 Low Priority (action within 6 months)

- Ensure that all hazardous chemicals stored on site, in particular those in the Level 13 Cooling Tower Room, are stored within appropriate secondary containment.
- Ensure the unlabelled containers in the Level 3 Plant Room and the Level 13 Cooling Tower Room are either appropriately labelled or removed from the site.
- Install an appropriate spill kit in the Level 3 Cleaners Store Room.
- Install an emergency eye wash station adjacent to (within 2-10m) the Class 8 corrosive substances stored in the Level 3 Cleaners Store Room or the Level 13 Cooling Tower Room.
- Ensure that printed SDS copies are available and readily accessible for all hazardous chemicals in each relevant storage area, as well as within a central storage hub.
- Replace any outdated SDSs with current copies.
- Require as a condition of service contract, that all contractors engaged at the site provide a register of the chemicals they intend to use/store on site as well as a current SDS.
- Ensure all staff and contractors working within chemical storage areas at the site are provided with appropriate information, instruction and training to ensure they are able to work safely in these areas. It is recommended that this be managed within the site induction.
- Implement a periodic hazardous chemicals assessment at the site to ensure the requirements are being maintained and the register remains current. It is recommended that such a review is performed at least annually, or when significant changes are made to the hazardous chemicals used/stored on site.
- A copy of this report and register should be made available to any staff and contractors working within the relevant areas at the site.

7. REFERENCES

- Occupational Health & Safety Act, 2004.
- Dangerous Goods Act, 1985.
- Occupational Health & Safety Regulations, 2017.
- Dangerous Goods (Storage & Handling) Regulations, 2012.
- Code of Practice for the Storage and Handling of Dangerous Goods, 2013.
- Compliance Code: Hazardous Substances, 2019.

- Australian Standard 1940:2017 'The Storage and Handling of Flammable and Combustible Liquids'.
- Australian Standard 1596:2014 'The Storage and Handling of LP Gas'.
- Australian Standard 3833:2007 'The Storage and Handling of Mixed Classes of Dangerous Goods in Packages and Intermediate Bulk Containers'.

8. LIMITATIONS

This report and the associated services performed by Tetra Tech are in accordance with the scope of services set out in the contract between Tetra Tech and the Client. The scope of services was defined by the requests of the Client, by the time and budgetary constraints imposed by the Client, and by the availability of access to the site.

Tetra Tech derived the data in this report primarily from visual inspections, examination of available records, and interviews with individuals with relevant information about the site. In preparing this report, Tetra Tech has relied upon, and presumed accurate, certain information (or absence thereof) provided by government authorities, the Client and others identified herein. Except as otherwise stated in the report, Tetra Tech has not attempted to verify the accuracy or completeness of any such information.

No warranty, undertaking, or guarantee, whether expressed or implied, is made with respect to the data reported or to the findings, observations, and recommendations expressed in this report. Furthermore, such data, findings, observations, and recommendations are based solely upon existence at the time of the assessment. The passage of time, manifestation of latent conditions or impacts of future events (e.g. changes in legislation, scientific knowledge, land uses, etc.) may require further investigation at the site with subsequent data analysis and re-evaluation of the findings, observations, and recommendations expressed in this report.

This report has been prepared on behalf of and for the exclusive use of the Client, and is subject to and issued in connection with the provisions of the agreement between Tetra Tech and the Client. Tetra Tech accepts no liability or responsibility whatsoever and expressly disclaims any responsibility for or in respect of any use of or reliance upon this report by any third party or parties. It is the responsibility of the Client to accept if the Client so chooses any recommendations contained within and implement them in an appropriate, suitable and timely manner.

APPENDIX A: PHOTOGRAPHS



Photo 01. Spill kit in Fire Pump Room.



Photo 02. Chemical storage in Level 13 Cooling Tower Area. Chemical containers stored without secondary containment.



Photo 03. Unlabelled container in Level 13 Cooling Tower Area.

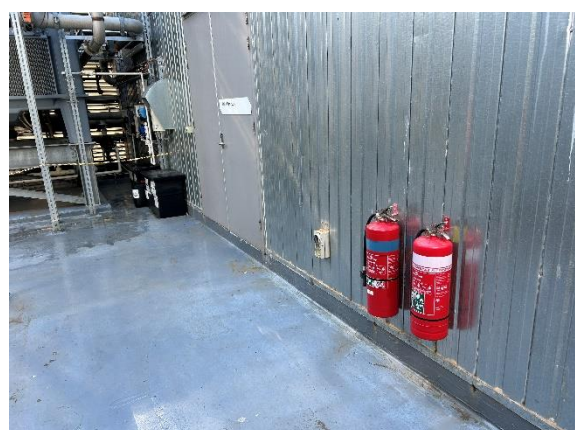


Photo 04. Fire extinguishers adjacent to diesel storage in Level 13 Cooling Tower Area.



Photo 05. Chemical storage in Level 3 Cleaners Store Room.



Photo 06. Class 3 and Class 8 chemicals stored together in Level 3 Cleaners Store Room.

APPENDIX B: HAZARDOUS CHEMICALS REGISTER

HAZARDOUS CHEMICALS REGISTER

Instructions

Complete, keep and maintain this *Hazardous Chemicals Register* for all existing and new chemicals used by staff. This register should be readily accessible by all staff and contractors who use or who may be affected or exposed to any of the hazardous chemicals listed herein.

All hazardous chemicals must have a current safety data sheet (SDS) and an accompanying risk assessment that is no more than five years old. The SDS must state whether the product is hazardous and, in case of dangerous goods, provide the proper shipping name, class label, subsidiary risk, and packing group details. Copies of the SDSs must be attached to this register.

Site		664 Collins Street, Docklands, Victoria			
Date of Register		5 th June 2024 (based on 22 nd April 2024 inspection)			
Assessor	Name	Ben McCann	PositionTitle	Senior Associate – Property Risk	
	Company	Tetra Tech Coffey	Client Contact Name	Emma Brown	

Product Name	Purpose	Location	Quantity		Hazardous Substance	Dangerous Goods		SDS Expiry	Actions/Comments
			Number of Containers	Max Quantity (L or Kg)		Class	Packing Group		
Level 3, Cleaners Store Room									
Diversey Taski Glance	Cleaner	Level 3, Cleaners Store Room	4 x 5L 3 x 0.6L	21.8L	-	-	-	Not available	Provide current SDS in a readily accessible location
Diversey Taski Cream Cleanser R7	Cleaner	Level 3, Cleaners Store Room	4 x 5L	20L	-	-	-	Feb 2028	-
Diversey Taski Wipeout	Cleaner	Level 3, Cleaners Store Room	1 x 5L	5L	Yes	-	-	Feb 2024	Replace outdated SDS with current version
Diversey Taski Pro Strip HD	Cleaner	Level 3, Cleaners Store Room	2 x 5L	10L	Yes	8	III	Nov 2028	Store at least 3m away from Class 3 chemicals.

HAZARDOUS CHEMICALS REGISTER

Product Name	Purpose	Location	Quantity		Hazardous Substance	Dangerous Goods		SDS Expiry	Actions/Comments
			Number of Containers	Max Quantity (L or Kg)		Class	Packing Group		
Diversey Divercleanse	Cleaner	Level 3, Cleaners Store Room	3 x 5L 4 x 0.75L	18L	Yes	8	III	Dec 2027	Store at least 3m away from Class 3 chemicals.
Diversey Aqua Blue	Cleaner	Level 3, Cleaners Store Room	1 x 12kg	12kg	Yes	-	-	Dec 2027	-
Central Cleaning Supplies Graffiti Remover	Cleaner	Level 3, Cleaners Store Room	1 x 5L	5L	-	-	-	Not available	Provide current SDS in a readily accessible location
Central Cleaning Supplies Liquid Hand wash	Cleaner	Level 3, Cleaners Store Room	8 x 5L	40L	Yes	-	-	Not available	Provide current SDS in a readily accessible location
Sanitiz Hand Sanitiser	Cleaner	Level 3, Cleaners Store Room	1 x 5L	5L	Yes	3	2	Not available	Store at least 3m away from Class 8 chemicals. Provide current SDS in a readily accessible location
Agar Ph-7	Cleaner	Level 3, Cleaners Store Room	4 x 5L	20L	Yes	-	-	Apr 2026	-
Agar Double Bubble	Cleaner	Level 3, Cleaners Store Room	8 x 5L	40L	-	-	-	Sept 2025	-
Agar Escalator Cleaner	Cleaner	Level 3, Cleaners Store Room	1 x 5L	5L	Yes	-	-	Aug 2025	-
Agar Exit	Cleaner	Level 3, Cleaners Store Room	2 x 5L	10L	Yes	-	-	Oct 2025	-
Agar Steel Shine	Cleaner	Level 3, Cleaners Store Room	1 x 5L 3 x 0.5L	6.5L	Yes	-	-	Feb 2026	-
Agar Once Off	Cleaner	Level 3, Cleaners Store Room	1 x 5L	5	Yes	8	II	Oct 2025	Store at least 3m away from Class 3 chemicals.
Netbiokem DSAM Commercial grade Disinfectant	Cleaner	Level 3, Cleaners Store Room	3 x 0.6L	1.8L	Yes	-	-	Feb 2025	-

HAZARDOUS CHEMICALS REGISTER

Product Name	Purpose	Location	Quantity		Hazardous Substance	Dangerous Goods		SDS Expiry	Actions/Comments
			Number of Containers	Max Quantity (L or Kg)		Class	Packing Group		
Level 3, Fire Pump Room									
Diesel	Fuel	Level 3, Fire Pump Room	1 x 100L	100L	Yes	C1	N/A	Dec 2025	-
Zeal 12V Batteries	Battery	Level 3, Fire Pump Room	3 x units	3 x units	Yes	8	N/A	Not available	Provide current SDS in a readily accessible location
Level 3, Plant Room									
Unlabelled container	Unknown	Level 3, Plant Room, dosing pot	1 x 8L	8L	Unknown	Unknown	Unknown	Not available	Install an appropriate label on the container. Provide current SDS in a readily accessible location
Level 13, Cooling Tower Area									
Diesel	Fuel	Level 13, Cooling Tower Area, generator day tank	1 x 1,000L	1,000L	Yes	C1	N/A	Dec 2025	-
Century 12V Batteries	Battery	Level 13, Cooling Tower Area, generator enclosure	2 x units	2 x units	Yes	8	N/A	Sept 2024	-
Hydro 375	Water treatment	Level 13, Cooling Tower Area, adjacent CT1	1 x 15kg	30kg	Yes	5.1 (8)	II	Jun 2026	-
		Level 13, Cooling Tower Area, adjacent CT1, dosing pot	1 x 15kg						
Hydro 256	Water treatment	Level 13, Cooling Tower Area, adjacent CT1	1 x 15L	15L	Yes	8	III	Feb 2023	Replace outdated SDS with current version
Hydro 408X	Water treatment	Level 13, Cooling Tower Area, adjacent CT1	1 x 15L	15L	-	-	-	Not available	Provide current SDS in a readily accessible location

HAZARDOUS CHEMICALS REGISTER

Product Name	Purpose	Location	Quantity		Hazardous Substance	Dangerous Goods		SDS Expiry	Actions/Comments
			Number of Containers	Max Quantity (L or Kg)		Class	Packing Group		
Hydro 260X	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 15L	15L	Yes	8	III	Not available	Provide current SDS in a readily accessible location
Hydro 408X	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	2 x 15L	30L	-	-	-	Not available	Provide current SDS in a readily accessible location
Hydro 256	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	2 x 15L	30L	Yes	8	III	Feb 2023	Replace outdated SDS with current version
Hydro 424	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 15L	15L	Yes	-	-	March 2026	-
Hydro 360	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	3 x 15L	45L	Yes	8	III	Mar 2026	-
Hydro 326	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 4kg	4kg	-	-	-	Not available	Provide current SDS in a readily accessible location
Hydro 5801	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 5L	5L	Yes	8	III	Not available	Provide current SDS in a readily accessible location
Hydro 231	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 5L	5L	Yes	8	III	Not available	Provide current SDS in a readily accessible location
Hydro 348	Water treatment	Level 13, Cooling Tower Area, adjacent CT3	1 x 5L	5L	-	-	-	Not available	Provide current SDS in a readily accessible location
Unlabelled container	Unknown	Level 13, Cooling Tower Area, adjacent CT3	1 x 5L	5L	Unknown	Unknown	Unknown	Not available	Install an appropriate label on the container or remove from the site. Provide current SDS in a readily accessible location

HAZARDOUS CHEMICALS REGISTER

Product Name	Purpose	Location	Quantity		Hazardous Substance	Dangerous Goods		SDS Expiry	Actions/Comments
			Number of Containers	Max Quantity (L or Kg)		Class	Packing Group		
Level 13, Chiller Plant Room									
Hydro 428	Water treatment	Level 13, Chiller Plant Room	1 x 15L	45L	Yes	-	-	Dec 2026	-
		Level 13, Chiller Plant Room, dosing pot	2 x 15L						
R-134a	Refrigerant	Level 13, Chiller Plant Room, chillers	1 x 241Kg 2 x 385Kg	1,510kg	Yes	2.2	N/A	Jan 2025	-
		Level 13, Chiller Plant Room, recovery tank	1 x 499kg						